


4 ANCHOR BOLTS

R334

200

120

120°

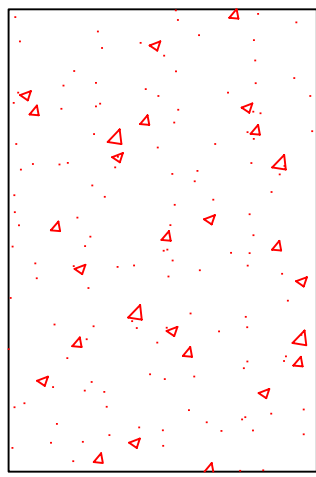

A

NET WELGHT	OPERATING WELGHT	LOADING POINT
85	245	F
		82

NOTES:

1. THE COOLING TOWER MUST BE LOCATED AT SUCH DISTANCE AND DIRECTION TO AVOID THE POSSIBILITY OF CONTAMINATED TOWER DISCHARGE AIR BEING DRAWN INTO BUILDING FRESH AIR INTAKES
2. ANCHOR BOLT BY OTHERS.

APPROVED			DWG TITLE:	TOWER FOUNDATION		
CHECKED			DWG DETAIL:	FT-20		
DRAWN	ZENG	2007.08.20.	DWG NO.	AFT-0020-E0	SCALE	1:5
			SHENZHEN RYOWO COOLING TOWER CO.,LTD.			