


DETAIL A 1:10

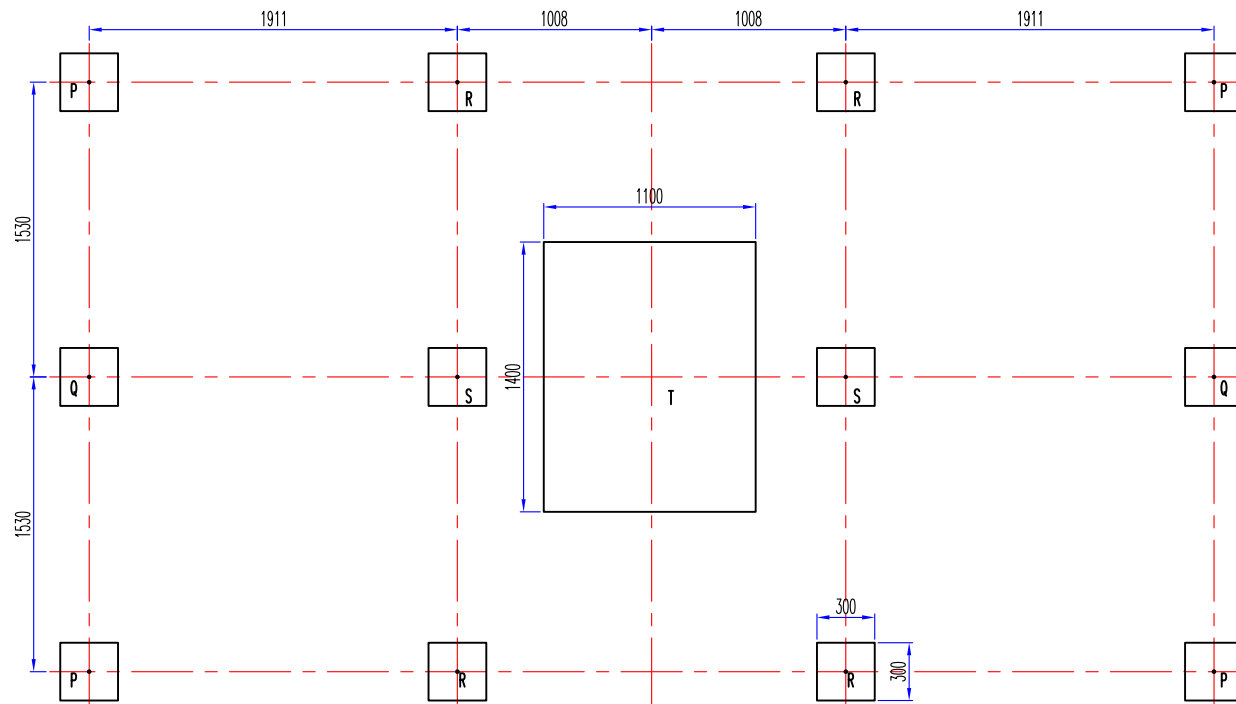

NET WEIGHT	OPERATING WEIGHT	LOADING POINT				
		P	R	Q	S	T
2993	7293	310.2	520.1	620.5	1040.3	650

UNIT:Kg

NOTES:

1. THE COOLING TOWER MUST BE LOCATED AT SUCH DISTANCE AND DIRECTION TO AVOID THE POSSIBILITY OF CONTAMINATED TOWER DISCHARGE AIR BEING DRAWN INTO BUILDING FRESH AIR INTAKES
2. ANCHOR BOLT BY OTHERS

APPROVED	KM LIN	2007.07.02.	DWG TITLE:	TOWER FOUNDATION		
CHECKED	HUANG	2007.07.02.	DWG DETAIL:	FWS-300-11		
			DWG NO.	AFWS-0300-110-E0	SCALE	1:40
DRAWN	WEN	2007.07.02.	SHENZHEN RYOWO COOLING TOWER CO.,LTD.			